
SUPPLY AIR FILTER AND RETURN AIR DUCT SMOKE DETECTION SYSTEM

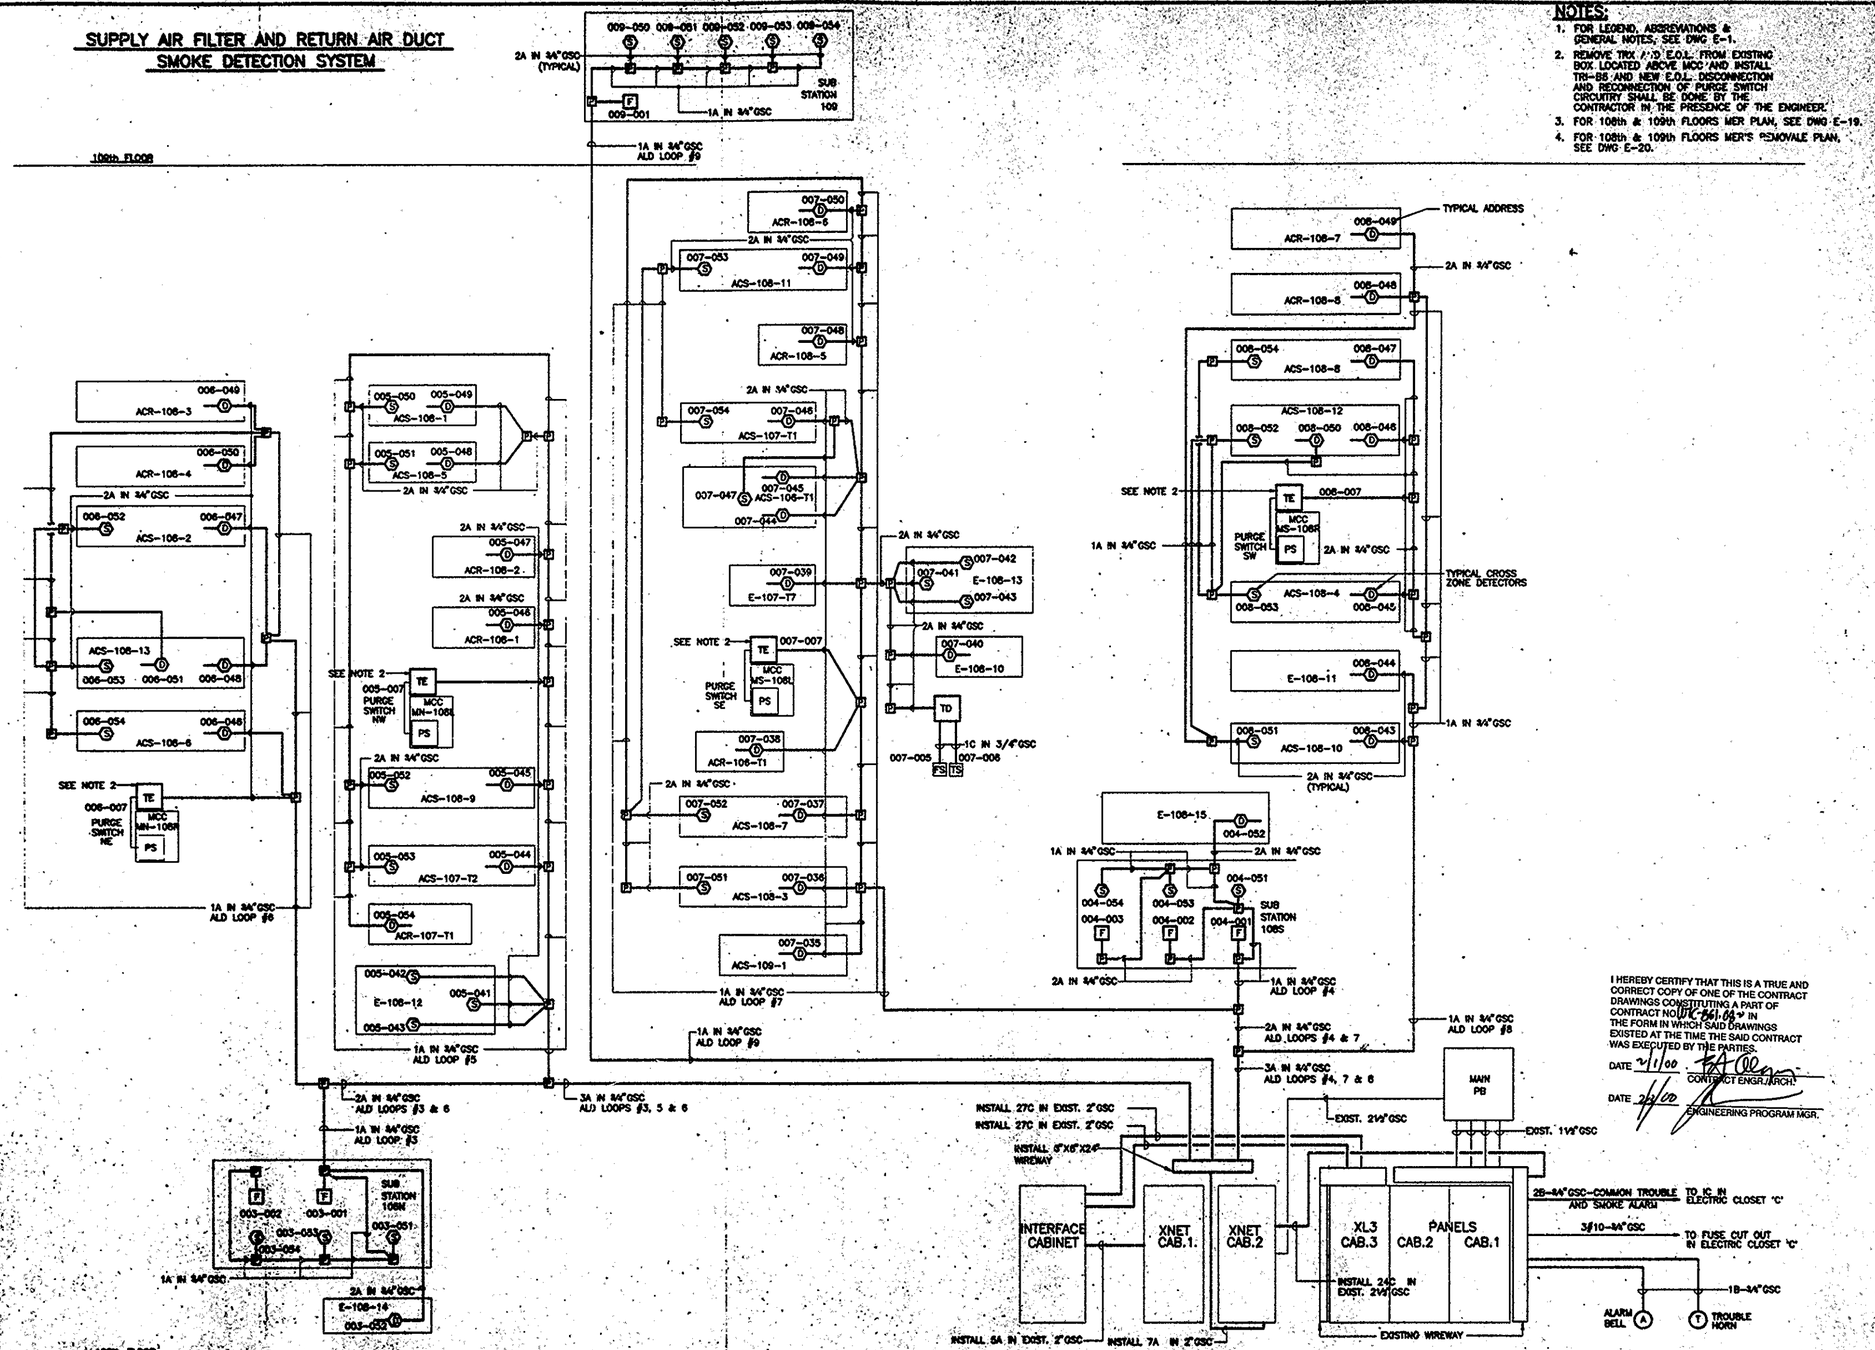

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX A/D E.O.L. FROM EXISTING BOX LOCATED ABOVE MCC AND INSTALL TRI-BS AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 108th & 109th FLOORS MER PLAN, SEE DWG E-19.
4. FOR 108th & 109th FLOORS MER'S REMOVALE PLAN, SEE DWG E-20.

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861.084 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 4/11/00 CONTRACT ENGR./ARCH.

DATE 4/11/00 ENGINEERING PROGRAM MGR.

Sheet 20 of 58

THE PORT AUTHORITY OF NY & NJ

ENGINEERING PROGRAM MANAGER WORLD TRADE

CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved

Engineering Department
Design Division
The World Trade Center

Title
FIRE ALARM SYSTEM PHASE III XL3 CONVERSION ELECTRICAL
1 WTC 108th FLOOR MER FIRE ALARM SYSTEM RISER DIAGRAM

This drawing subject to conditions in contract. All inventions, ideas, designs, and methods herein are reserved to Port Authority and may not be used without its written consent.

Designed by	Drawn by	Checked by
ROYZMAN FELDSTEIN	ROYZMAN	A. S.

Date 5-20-99 Scale NONE

Contract Number WTC-861.082 Drawing Number E-18